PowerPanel® Business Edition Installation Guide

For

UPS with Remote Management Card

Rev. 17

2015/11/6

Table of Contents

Introduction **3**
Hardware Installation **3**
Installing PowerPanel® Business Edition Software **3**
Installation on Windows 4
Installation on Linux 6
Installation in Text Mode 9
Installation on Mac 9
Installation on VMware ESXi and ESX 12
Installation on ESXi 12
Installation on ESX 13
Virtual Appliance Deployment on ESXi 13
Installation on XenServer 17
Installation on Hyper-V Server 17
Access PowerPanel® Business Edition Software Interface **17**
Quick Configuration 18
Configure Power Protection for Computers **18**
Import Profile 19
Configure Authentication 19
Assign IP Address of UPS Units and Connected Outlet 19
Configure Shutdown Settings 19
Setup Necessary Shutdown Time 19
Configure Shutdown Action for ESXi 19
Configure Startup and Shutdown of Virtual Machines on ESXi 20
Configure Shutdown of Virtual Machines on Hyper-V Server 21
Configure Actions for Essential Events 22
Make Sure Power Configuration is Correct 23
Mass Deployment **23**
Manage UPS Units in Center **24**
Add UPS Units 24

Introduction

A UPS with a remote management card (RMCARD) can provide access to the UPS directly via the network. It provides a service to monitor the status and configure the UPS through the network. It also logs the UPS status and power events.

The PowerPanel® Business Edition Client running on the host can communicate with the UPS via the network. In the event of power failure, the Client will be informed of this condition from the RMCARD and request the hosted computer to shut down completely before the UPS stops supplying power due to the battery power being exhausted. It can be installed on various platforms to initiate a shutdown during a power outage including Windows, Linux, Citrix XenServer and VMware ESX/ESXi. The following sections describe installation on the various platforms.

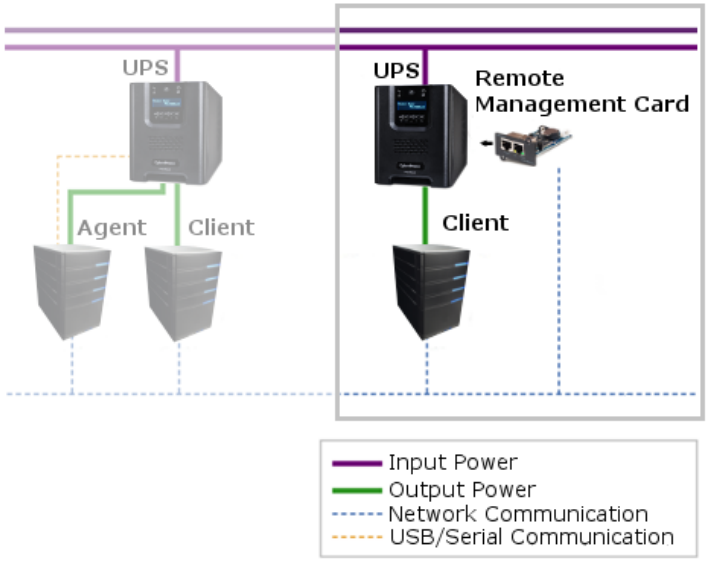

The UPS can establish communication with the PowerPanel® Business Edition Center via the network. The Center serves to simultaneously monitor and manage multiple UPS units. When the UPS stops supplying power, any computers running the PowerPanel® Business Edition Client, are shut down in advance to avoid a system crash or data loss.

Hardware Installation

Before installing the PowerPanel® Business Edition software, make sure that the following hardware installations are configured properly:

- Verify the computer's power is connected to the UPS outlet properly.
- Verify the computer's network is connected.
- Verify the RMCARD's network is connected.

Please refer to the **Remote Management Card User's Manual** for a proper hardware installation.

Installing PowerPanel® Business Edition Software

Installation on Windows

A popup window will be displayed automatically when inserting the PowerPanel® Business Edition installation CD. Users can click the **Install PowerPanel Business Edition software** shortcut on the window to initiate the installation procedure. If the popup window is not displayed when inserting the CD, browse to the CD drive and open the folder which locates at **/Software/Windows** then double click the file named **Setup.exe** to start the installation procedure. To install follow these steps:

- Click the **Next** button to start the installation.

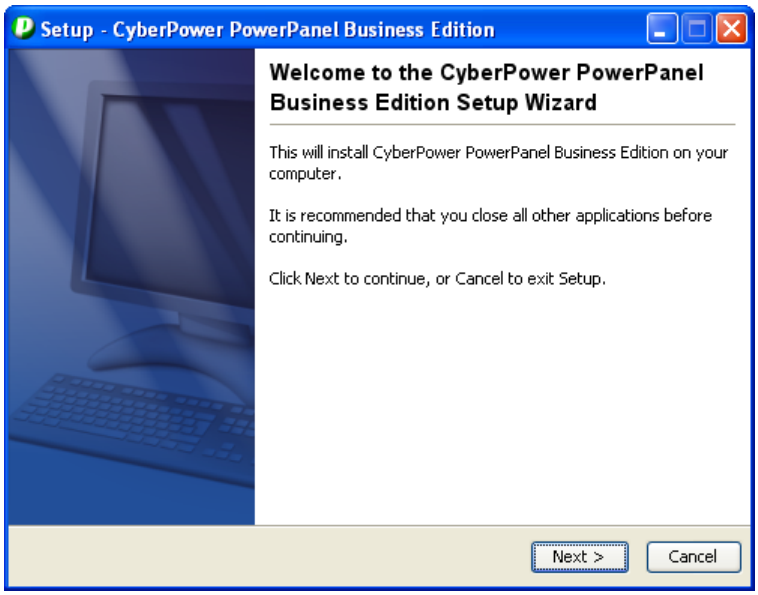
Setup - CyberPower PowerPanel Business Edition
Welcome to the CyberPower PowerPanel Business Edition Setup Wizard
This will install CyberPower PowerPanel Business Edition on your computer.
It is recommended that you close all other applications before continuing.
Click Next to continue, or Cancel to exit Setup.
Next >
Cancel

- Accept the license agreement.

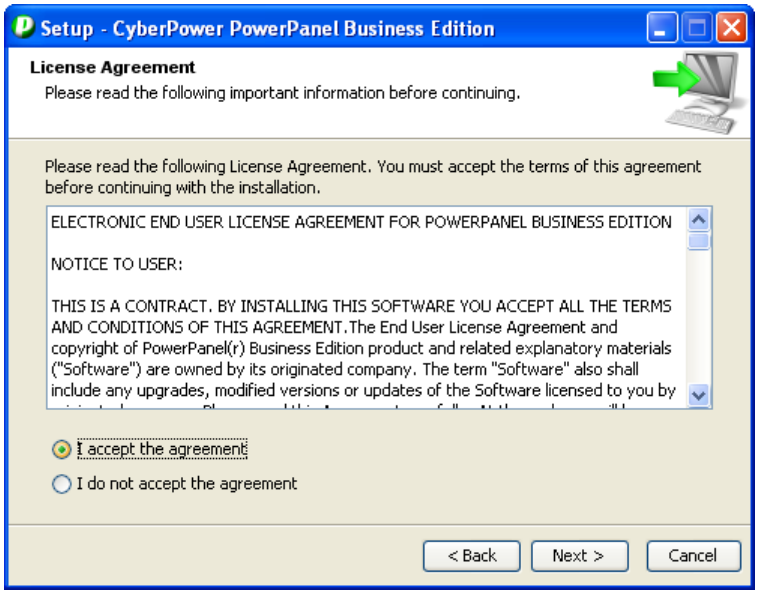
Setup - CyberPower PowerPanel Business Edition
License Agreement
Please read the following important information before continuing.
Please read the following License Agreement. You must accept the terms of this agreement before continuing with the installation.
ELECTRONIC END USER LICENSE AGREEMENT FOR POWERPANEL BUSINESS EDITION
NOTICE TO USER:
THIS IS A CONTRACT. BY INSTALLING THIS SOFTWARE YOU ACCEPT ALL THE TERMS AND CONDITIONS OF THIS AGREEMENT. The End User License Agreement and copyright of PowerPanel(r) Business Edition product and related explanatory materials ("Software") are owned by its originated company. The term "Software" also shall include any upgrades, modified versions or updates of the Software licensed to you by
I accept the agreement
I do not accept the agreement
< Back
Next >
Cancel

- **Choose the component.** In order to monitor multiple UPS units simultaneously, Center should be installed. If one single computer is powered by the UPS with an RMCARD installed, Client should be installed.

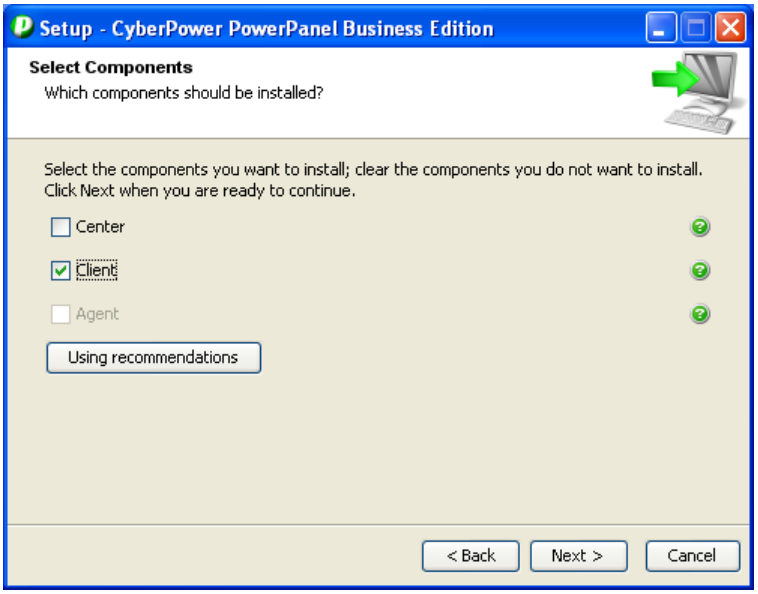
Setup - CyberPower PowerPanel Business Edition
Select Components
Which components should be installed?
Select the components you want to install; clear the components you do not want to install. Click Next when you are ready to continue.
Center
Client
Agent
Using recommendations
< Back
Next >
Cancel

- Choose the destination directory.

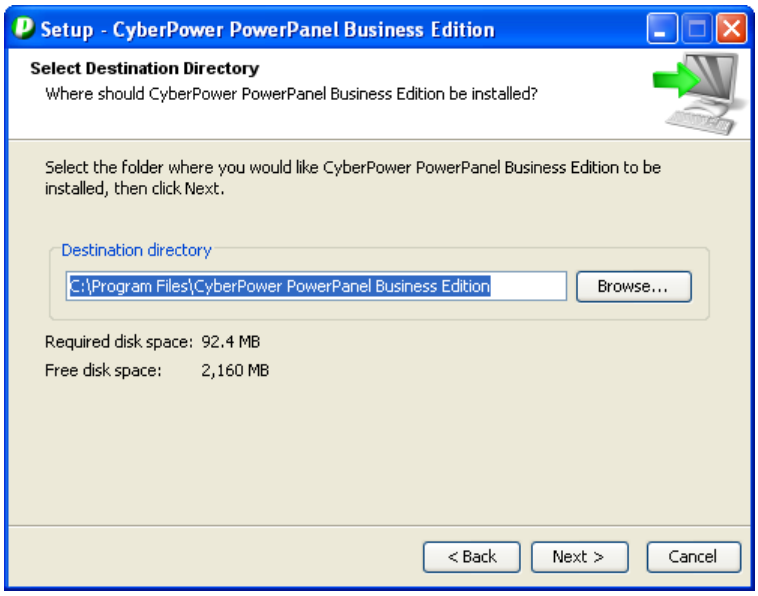
Setup - CyberPower PowerPanel Business Edition
Select Destination Directory
Where should CyberPower PowerPanel Business Edition be installed?
Select the folder where you would like CyberPower PowerPanel Business Edition to be installed, then click Next.
Destination directory
C:\Program Files\CyberPower PowerPanel Business Edition
Browse...
Required disk space: 92.4 MB
Free disk space: 2,160 MB
< Back
Next >
Cancel

- Choose the start menu folder.

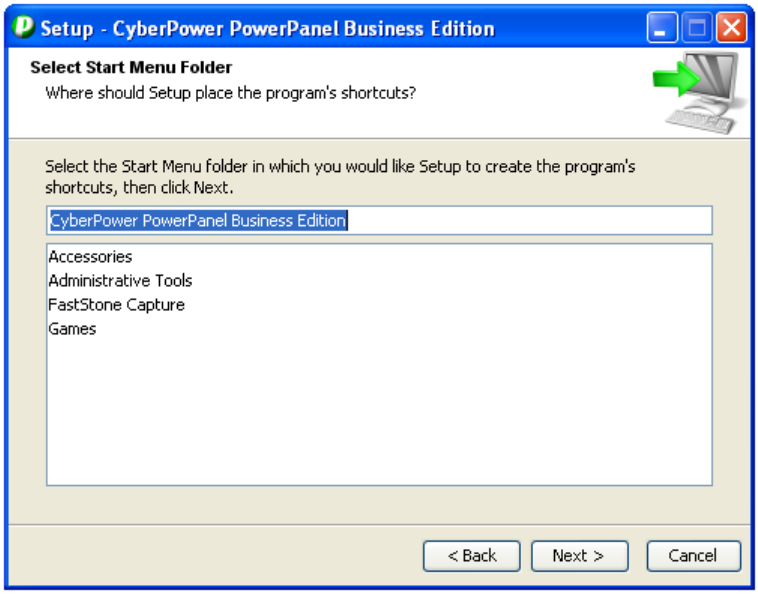
Setup - CyberPower PowerPanel Business Edition
Select Start Menu Folder
Where should Setup place the program's shortcuts?
Select the Start Menu folder in which you would like Setup to create the program's shortcuts, then click Next.
CyberPower PowerPanel Business Edition
Accessories
Administrative Tools
FastStone Capture
Games
< Back
Next >
Cancel

- Click the **Finish** button to complete the installation.

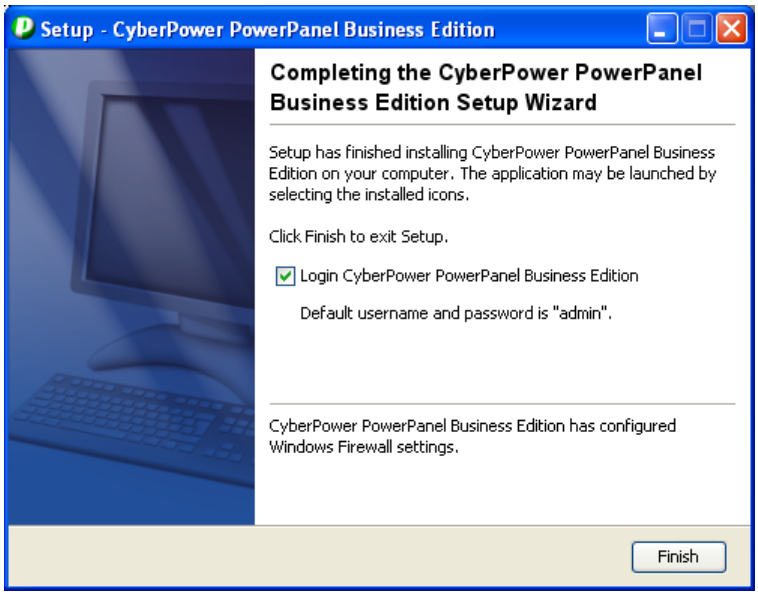
Setup - CyberPower PowerPanel Business Edition
Completing the CyberPower PowerPanel Business Edition Setup Wizard
Setup has finished installing CyberPower PowerPanel Business Edition on your computer. The application may be launched by selecting the installed icons.
Click Finish to exit Setup.
Login CyberPower PowerPanel Business Edition
Default username and password is "admin".
CyberPower PowerPanel Business Edition has configured Windows Firewall settings.
Finish

Installation on Linux

The installer is used to install the Client and requires root permission. The installation wizard will guide users to complete the installation. Browse the CD and find the installer in the **/Software/Linux** folder. Initiate an installation wizard by running the **./ppbe-linux-x86.sh** command or double clicking **ppbe-linux-x86.sh** from desktop on 32-bit Linux systems. Initiate an installation wizard by running the **./ppbe-linux-x86_64.sh** command or double clicking **ppbe-linux-x86_64.sh** from desktop on 64-bit systems.

*__Note:__ On Linux systems, users may mount the CD by using the mount command. Run **mount –t iso9660 /dev/cdrom /mnt/cdrom** as a root user. /dev/cdrom is the CD drive and /mnt/cdrom will be the mount point.*

To install follow these steps:

- Click the **Next** button to start an installation.

Setup - CyberPower PowerPanel Business Edition
Welcome to the CyberPower PowerPanel Business Edition Setup Wizard
This will install CyberPower PowerPanel Business Edition on your computer. The wizard will lead you step by step through the installation.
Click Next to continue, or Cancel to exit Setup.
Next >
Cancel

- Accept the license agreement.

Setup - CyberPower PowerPanel Business Edition
License Agreement
Please read the following important information before continuing.
Please read the following License Agreement. You must accept the terms of this agreement before continuing with the installation.
ELECTRONIC END USER LICENSE AGREEMENT FOR CYBERPOWER POWERPANEL BUSINESS EDITION
NOTICE TO USER:
THIS IS A CONTRACT. BY INSTALLING THIS SOFTWARE YOU ACCEPT ALL THE TERMS AND CONDITIONS OF THIS AGREEMENT.
I accept the agreement
I do not accept the agreement
< Back
Next >
Cancel

- **Choose the component.** In order to simultaneous monitor multiple UPS, Center should be installed. If one single computer which is powered by the UPS requiring protection, Client should be installed.

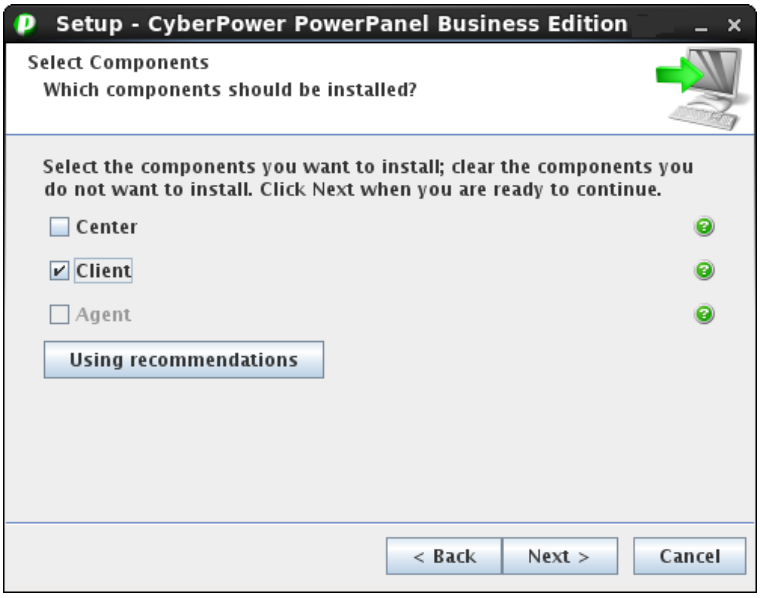
Setup - CyberPower PowerPanel Business Edition
Select Components
Which components should be installed?
Select the components you want to install; clear the components you do not want to install. Click Next when you are ready to continue.
Center
Client
Agent
Using recommendations
< Back
Next >
Cancel

- Choose the destination directory.

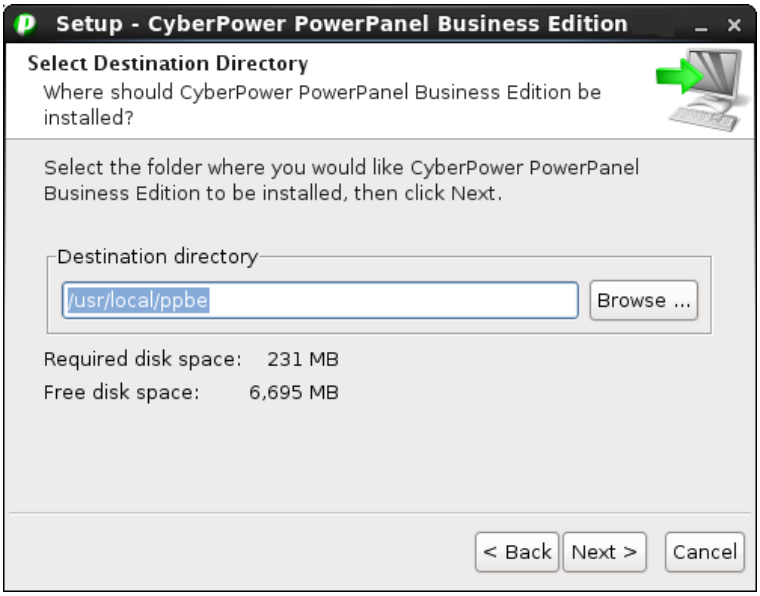
Setup - CyberPower PowerPanel Business Edition
Select Destination Directory
Where should CyberPower PowerPanel Business Edition be installed?
Select the folder where you would like CyberPower PowerPanel Business Edition to be installed, then click Next.
Destination directory
/usr/local/ppbe
Browse ...
Required disk space: 231 MB
Free disk space: 6,695 MB
< Back
Next >
Cancel

- Click the **Finish** button to complete the installation**.**

Setup - CyberPower PowerPanel Business Edition
Completing the CyberPower PowerPanel Business Edition Setup Wizard
Setup has finished installing CyberPower PowerPanel Business Edition on your computer. The application may be launched by executing the installed start scripts.
Click Finish to exit Setup.
Login CyberPower PowerPanel Business ...
Default username and password is "adm...
Finish

Installation in Text Mode

When the system does not support graphic mode, the Linux installation needs to be initiated in the terminal by using the **./ppbe-linux-x86.sh -c** command on 32-bit systems or use **./ppbe-linux-x86_64.sh -c** command on 64-bit systems.

The installation procedure will be initiated as following steps:

- Press **Enter** to start an installation.

```
Starting Installer ...
This will install CyberPower PowerPanel Business Edition on your computer.
OK [o, Enter], Cancel [c]
```

- **Accept the license agreement.**

```
YOUR ACCEPTANCE OF THE FOREGOING AGREEMENT WAS INDICATED DURING
INSTALLATION.

I accept the agreement
Yes [1], No [2]
```

- Determine to use recommendation before selecting the components. Select **n** to ignore the recommendation.

```
Select the components you want to install; clear the components you do not
want to install. Click Next when you are ready to continue.
Using recommendations
Yes [y, Enter], No [n]
```

- **Choose the component.** In order to monitor multiple UPS units simultaneously, Center should be installed. If one single computer is powered by the UPS, Client should be installed.

```
Which components should be installed?
Center [1], Client [2], Agent [3]
Please enter a comma-separated list of the selected values or [Enter] for the default selection:
```

- **Choose the destination directory.**

```
Where should CyberPower PowerPanel Business Edition be installed?
[/usr/local/ppbe]
```

- Installation procedure starts and once finished. It will end automatically.

```
Please wait for CyberPower PowerPanel Business Edition configuring
Default username and password is "admin".
CyberPower PowerPanel Business Edition may not do hibernation.
Finishing installation...
```

Installation on Mac

File folder will be displayed automatically when inserting the PowerPanel® Business Edition installation CD. Find the installer in the **/Software/Mac** folder, and double click the file named **Setup.dmg**, then in the same way double click the file named **CyberPower PowerPanel Business Edition Installer** to initiate the wizard. The installation wizard will guide users in completing the installation.

Note: *If PPBE service stopped in unexpected conditions and the OS X version is 10.6 or earlier. Please update*

Java to the latest version via ***Software Update****, then execute* ***restartService.sh*** *to restart PPBE service, the default file path is* ***/Applications/ppbe/bin/restartService.sh****.*

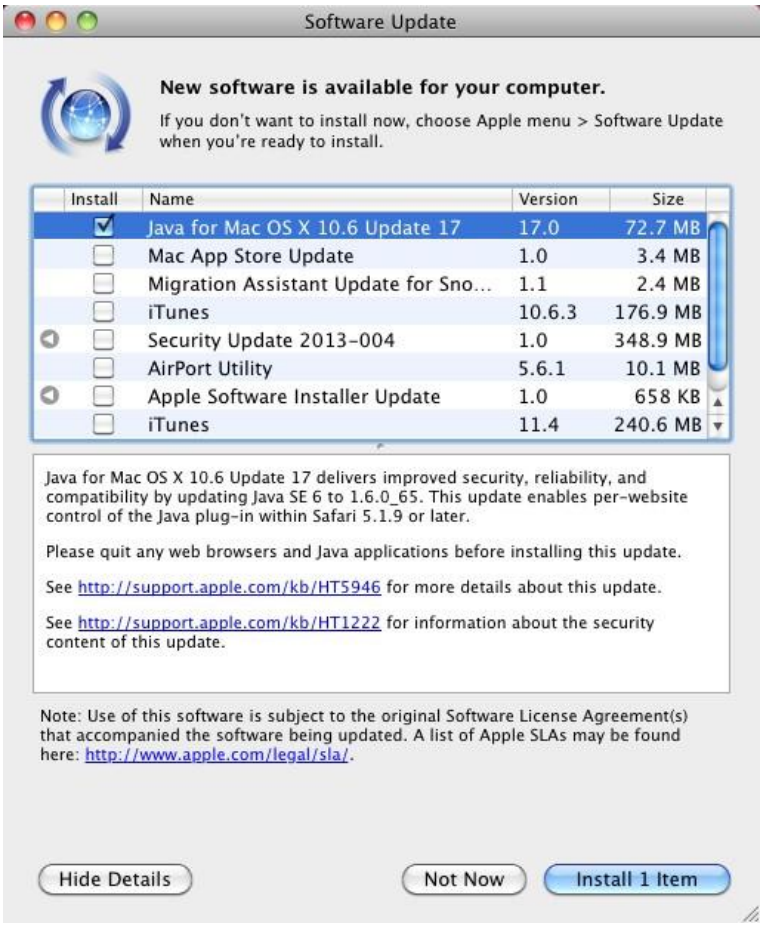
Software Update
New software is available for your computer.
If you don't want to install now, choose Apple menu > Software Update when you're ready to install.
Install
Name
Version
Size
Java for Mac OS X 10.6 Update 17
17.0
72.7 MB
Mac App Store Update
1.0
3.4 MB
Migration Assistant Update for Sno...
1.1
2.4 MB
iTunes
10.6.3
176.9 MB
Security Update 2013-004
1.0
348.9 MB
AirPort Utility
5.6.1
10.1 MB
Apple Software Installer Update
1.0
658 KB
iTunes
11.4
240.6 MB
Java for Mac OS X 10.6 Update 17 delivers improved security, reliability, and compatibility by updating Java SE 6 to 1.6.0_65. This update enables per-website control of the Java plug-in within Safari 5.1.9 or later.
Please quit any web browsers and Java applications before installing this update.
See http://support.apple.com/kb/HT5946 for more details about this update.
See http://support.apple.com/kb/HT1222 for information about the security content of this update.
Note: Use of this software is subject to the original Software License Agreement(s) that accompanied the software being updated. A list of Apple SLAs may be found here: http://www.apple.com/legal/sla/.
Hide Details
Not Now
Install 1 Item

Note: Cyberpower PowerPanel® Business Edition *software is a third-party application. At the first time to launch the PPBE installer on the Mac OS X 10.8(or later version), you should do following:*

1.Right-click the Installer and choose "Open".

2. Choose "Open" again at the dialog to open it.

To install follow these steps:

- Click the **Next** button to start an installation.

Setup - CyberPower PowerPanel Business Edition
Welcome to the CyberPower PowerPanel Business Edition Setup Wizard
This will install CyberPower PowerPanel Business Edition on your computer. The wizard will lead you step by step through the installation.
Click Next to continue, or Cancel to exit Setup.
Next >
Cancel

- Accept the license agreement.

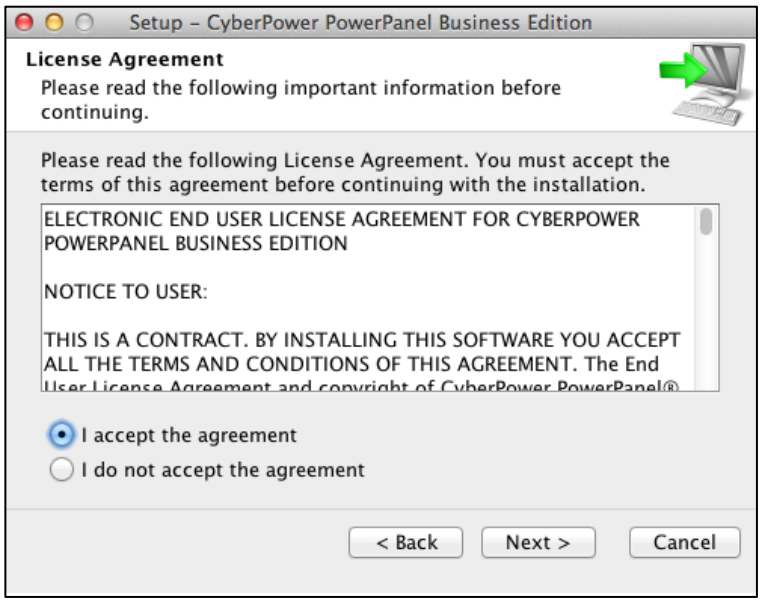
Setup – CyberPower PowerPanel Business Edition
License Agreement
Please read the following important information before continuing.
Please read the following License Agreement. You must accept the terms of this agreement before continuing with the installation.
ELECTRONIC END USER LICENSE AGREEMENT FOR CYBERPOWER POWERPANEL BUSINESS EDITION
NOTICE TO USER:
THIS IS A CONTRACT. BY INSTALLING THIS SOFTWARE YOU ACCEPT ALL THE TERMS AND CONDITIONS OF THIS AGREEMENT. The End
I accept the agreement
I do not accept the agreement
< Back
Next >
Cancel

- **Choose the component.** If one single computer is connected to the UPS directly via a USB or serial connection, Agent should be installed. If the computer is powered by a UPS already connected to an Agent, has a remote management card installed or is connected to a PDU, Client should be installed. If the administrator requires simultaneous monitoring and access to multiple UPS/PDU/ATSs, equipment and computers on a local network, Center should be installed.

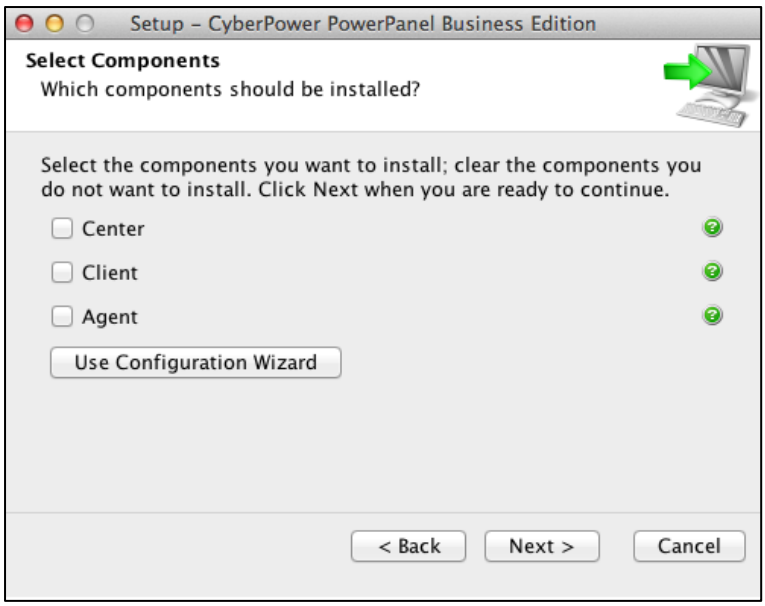
Setup – CyberPower PowerPanel Business Edition
Select Components
Which components should be installed?
Select the components you want to install; clear the components you do not want to install. Click Next when you are ready to continue.
Center
Client
Agent
Use Configuration Wizard
< Back
Next >
Cancel

- Choose the destination directory.

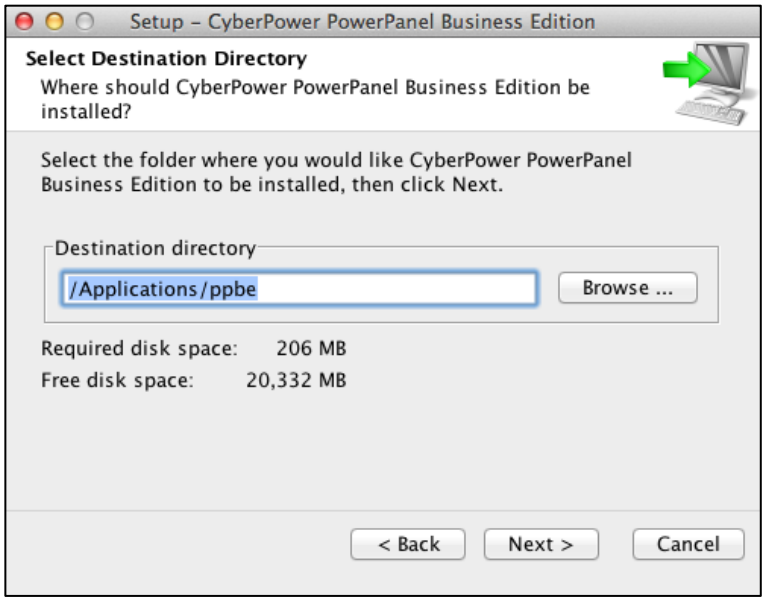
Setup – CyberPower PowerPanel Business Edition
Select Destination Directory
Where should CyberPower PowerPanel Business Edition be installed?
Select the folder where you would like CyberPower PowerPanel Business Edition to be installed, then click Next.
Destination directory
/Applications/ppbe
Browse ...
Required disk space: 206 MB
Free disk space: 20,332 MB
< Back
Next >
Cancel

- Click the **Finish** button to complete the installation**.**

Setup – CyberPower PowerPanel Business Edition
Completing the CyberPower PowerPanel Business Edition Setup Wizard
Setup has finished installing CyberPower PowerPanel Business Edition on your computer. The application may be launched by selecting the installed icons.
Click Finish to exit Setup.
Login CyberPower PowerPanel Business Edi...
Default username and password is "admin".
Finish

Installation on VMware ESXi and ESX

Installation on ESXi

Installation must be launched in the **vMA** (**vSphere Management Assistant**) which is also a virtual machine on the ESXi host. In order to deploy vMA on the ESXi host and install PPBE in the vMA, users must install the **vSphere Client** tool on another remote computer first. To download the vSphere Client installer, users can enter the ESXi host IP address to access the web page. Users can visit **VMware** website for ***vSphere Management Assistant Guide document*** about vMA deployment on VMware ESXi.

The installer will guide users in completing the installation. Refer to Installation on Text Mode section to follow the same steps to complete installation. The installer requires root permission to initiate the installation procedure. Mount CD by running **mount -t iso9660 /dev/cdrom /mnt/cdrom** as a root user.(**/dev/cdrom** is the CD drive and **/mnt/cdrom** will be the mount point.). Browse the CD drive and find the installer in the **/Software/Linux** folder. Initiate an installation

procedure by running the **./ppbe-linux-x86_64.sh** command.

Note: *In order to allow the interactions between physical and virtual machines, VMware tools have to be installed on each virtual machine. Refer to VMware ESX/ESXi Server documentation for further information about VMware Tools.*

Installation on ESX

Installation must be launched in the Service Console (aka Console Operation System). To initiate the installation procedure on VMware ESX also requires root permission. Use the same command to mount CD and initiate the installation procedure. Refer to Installation on Text Mode section to complete the installation.

Virtual Appliance Deployment on ESXi

A virtual appliance (VA) is a prebuilt software solution, comprised of one or more virtual machines that is packaged, maintained, updated and managed as a unit. It is fundamentally changing how software is developed, distributed, deployed and managed.

Download the PPBE virtual appliance which is pre-installed Client from CyberPower. In order to deploy the PPBE virtual appliance on VMware ESXi host, users must install **vSphere Client** tool first on another remote computer. To download the **vSphere Client** installer, users can enter the ESXi host IP address to access web page of ESXi host.

The deployment procedure will be initiated as below steps:

- Launch the vShpere Client. Open the **Deploy OVF Template** window from **File > Deploy OVF Template…** item.

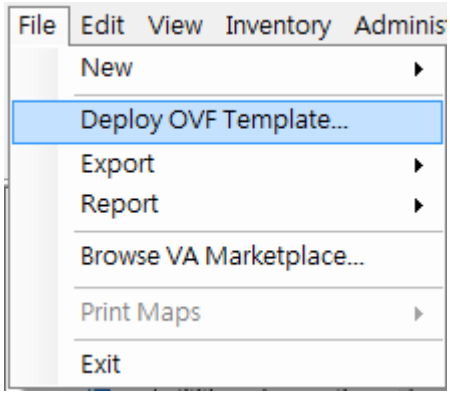

- Click **Browse** to import the **ppbeXXX_centos.ovf** extracted from the download zip file. Click **Next** to start a deployment task.

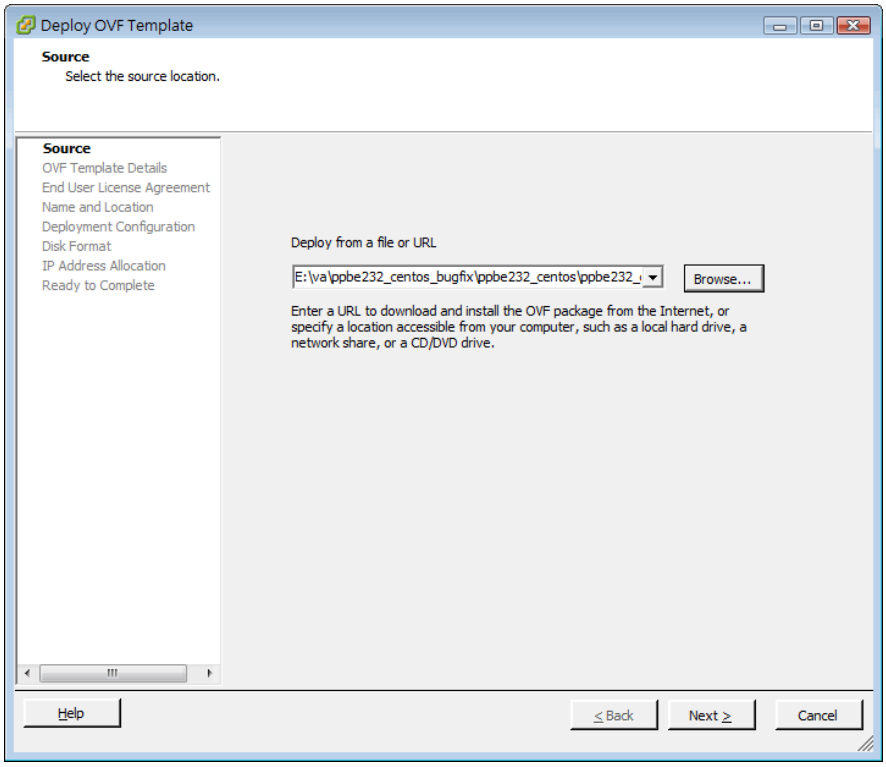
Deploy OVF Template
Source
Select the source location.
Source
OVF Template Details
End User License Agreement
Name and Location
Deployment Configuration
Disk Format
IP Address Allocation
Ready to Complete
Deploy from a file or URL
E:\va\ppbe232_centos_bugfix\ppbe232_centos\ppbe232_
Browse...
Enter a URL to download and install the OVF package from the Internet, or specify a location accessible from your computer, such as a local hard drive, a network share, or a CD/DVD drive.
Help
< Back
Next >
Cancel

- The OVF template detail is displayed. Click **Next** to continue.

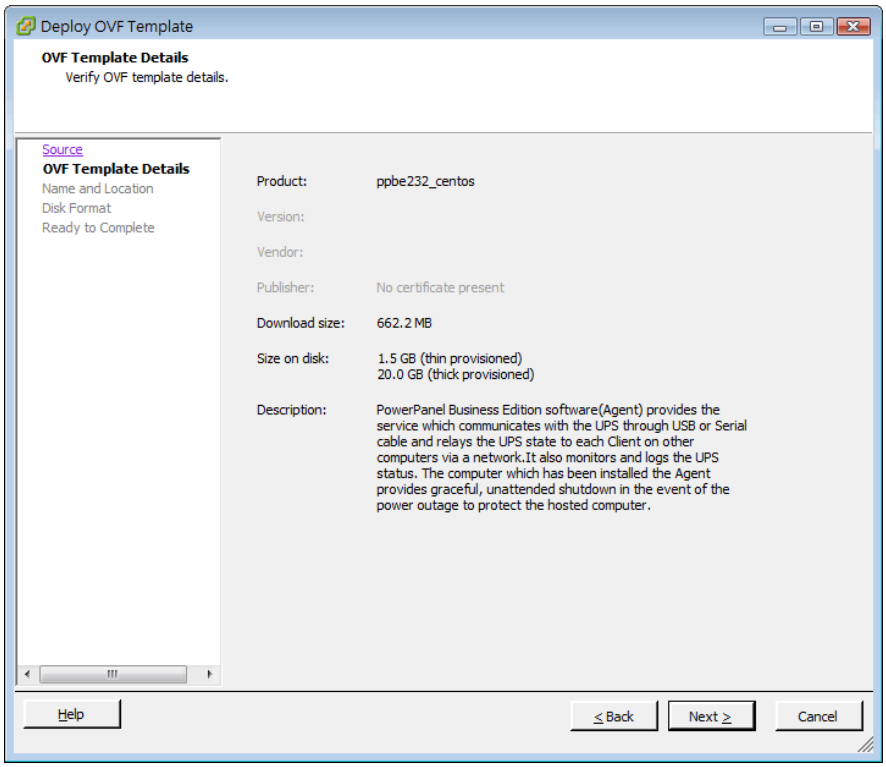
Deploy OVF Template
OVF Template Details
Verify OVF template details.
Source
OVF Template Details
Name and Location
Disk Format
Ready to Complete
Product: ppbe232_centos
Version:
Vendor:
Publisher: No certificate present
Download size: 662.2 MB
Size on disk: 1.5 GB (thin provisioned)
20.0 GB (thick provisioned)
Description: PowerPanel Business Edition software(Agent) provides the service which communicates with the UPS through USB or Serial cable and relays the UPS state to each Client on other computers via a network.It also monitors and logs the UPS status. The computer which has been installed the Agent provides graceful, unattended shutdown in the event of the power outage to protect the hosted computer.
Help
< Back
Next >
Cancel

- Enter the name for the deployed PPBE virtual appliance. This name should be unique within the inventory.

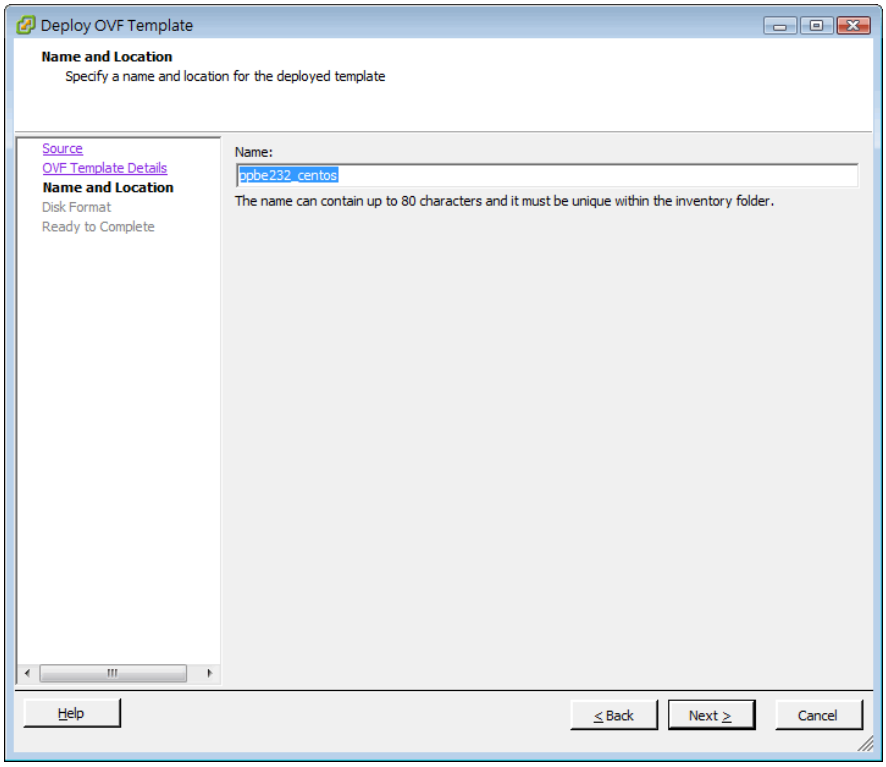

- Select the virtual disk format for the PPBE virtual appliance. The default option is **Thin Provision**. Refer to About Virtual Disk Provision Disk Policies for further information about how to select virtual disk format.

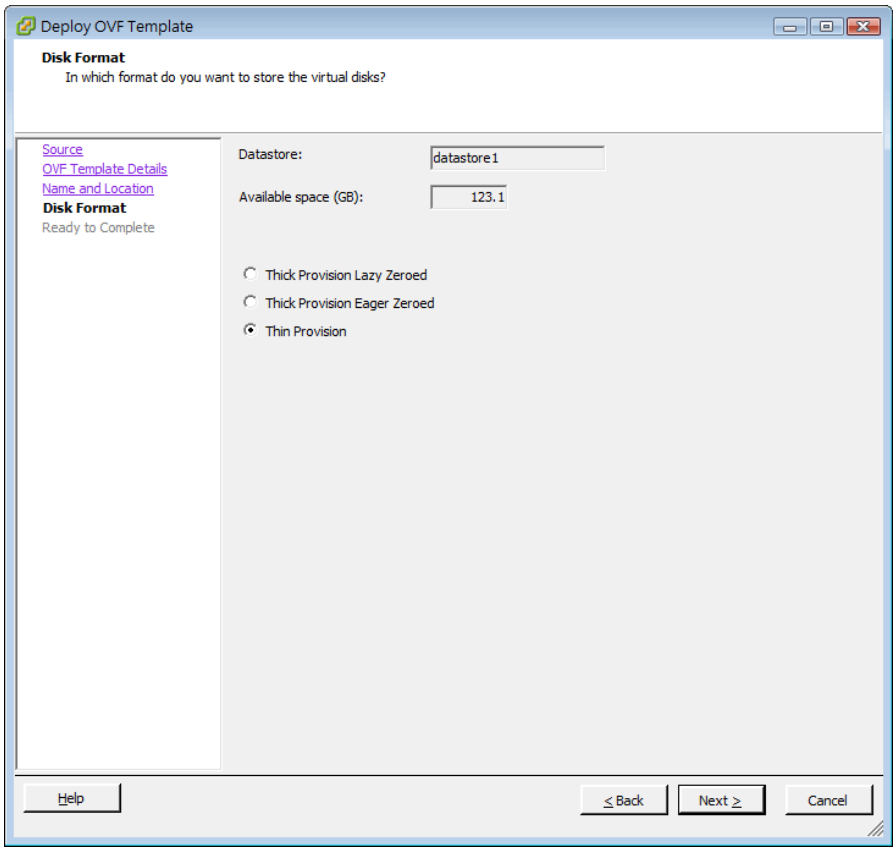

- A deployment detail is displayed. Click **Finish** to start the deployment task.

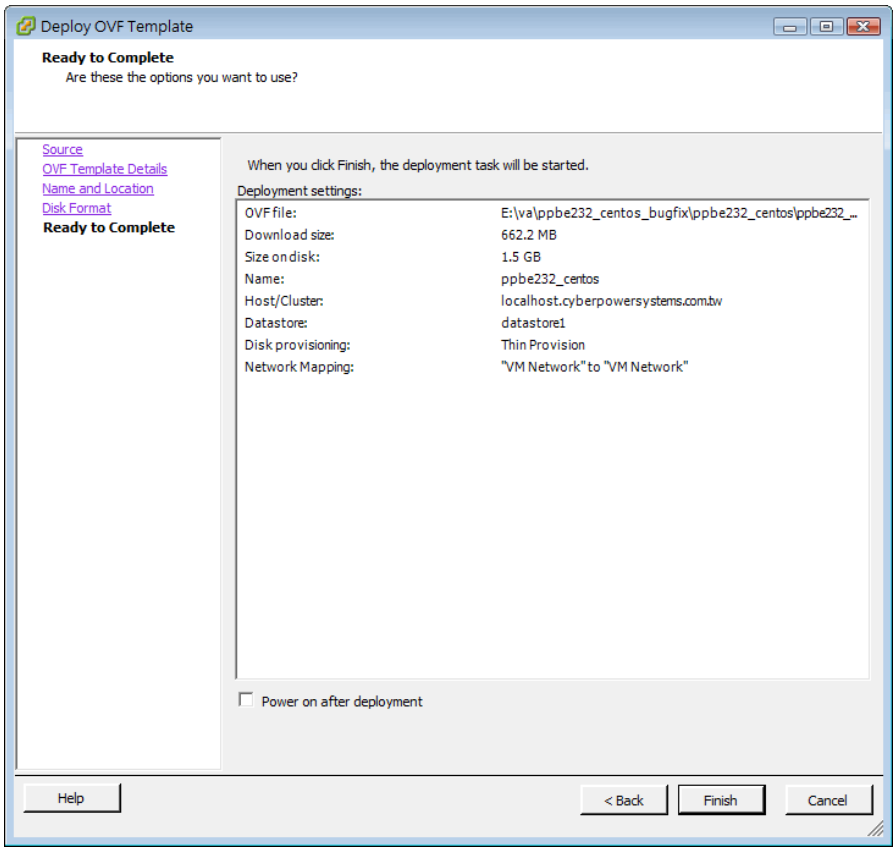

- After the deployment task is complete, the PPBE virtual appliance will be added into the inventory.

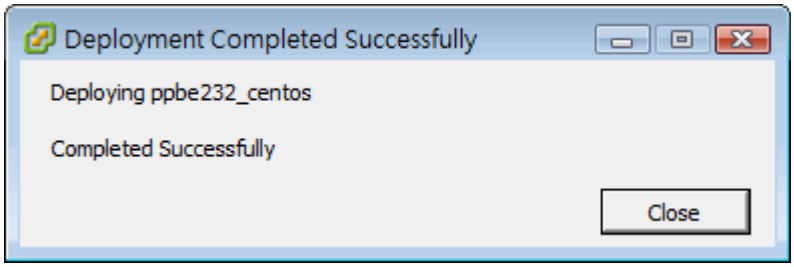

- Click **Power on the virtual machine** to power on the virtual machine and ready to access the Client.

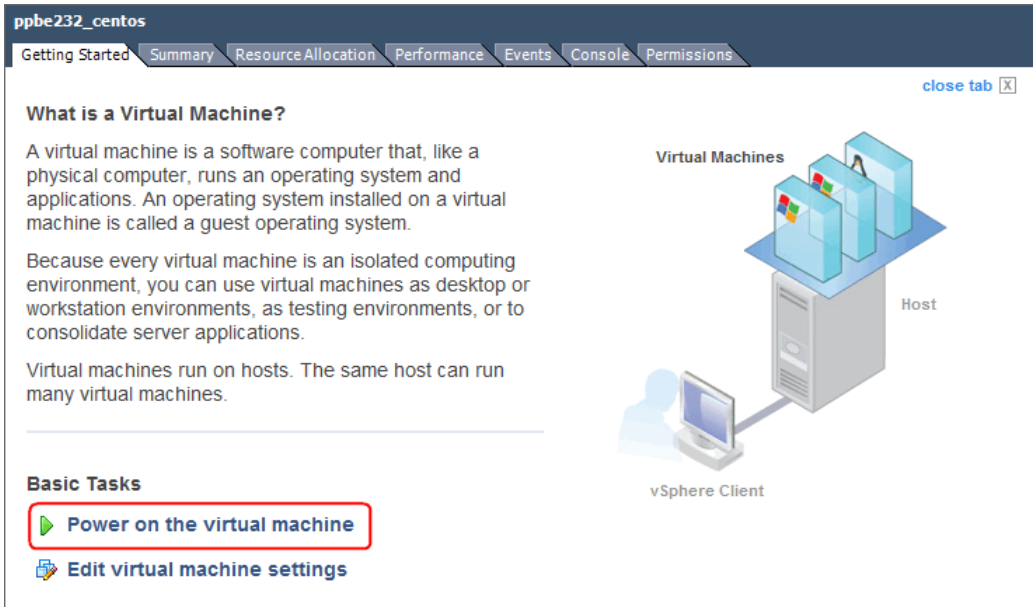
ppbe232_centos
Getting Started
Summary
Resource Allocation
Performance
Events
Console
Permissions
close tab
What is a Virtual Machine?
A virtual machine is a software computer that, like a physical computer, runs an operating system and applications. An operating system installed on a virtual machine is called a guest operating system.
Because every virtual machine is an isolated computing environment, you can use virtual machines as desktop or workstation environments, as testing environments, or to consolidate server applications.
Virtual machines run on hosts. The same host can run many virtual machines.
Virtual Machines
Host
vSphere Client
Basic Tasks
Power on the virtual machine
Edit virtual machine settings

- Login the virtual appliance. The default username and password are **admin.** In order to perform shutdown accurately, you must change the time zone settings of the virtual appliance.
  This can be a direct copy of the time zone file from the **/usr/share/zoneinfo** folder. We assume that the host is located under the Chicago CST zone in Chicago, and the time zone can be changed by running the command **cp /usr/share/zoneinfo/America/Chicago /etc/localtime**.

Installation on XenServer

The installer requires root permission to install the PowerPanel® Business Edition. Mount CD by running **mount -t iso9660 /dev/cdrom /mnt/cdrom** as a root user (**/dev/cdrom** is the CD drive and **/mnt/cdrom** will be the mount point.). Browse the CD drive and run **./ppbe-linux-x86.sh** command to initiate an installation procedure.

Installation must be launched on the **Dom0**. Refer to Installation on Text Mode section to complete the installation.

Installation on Hyper-V Server

Use the PowerPanel® Business Edition installation CD to complete the installation on the target computer. Run the ***<CD_Drive>\Software\Windows\setup.exe*** to start the installation procedure (***CD_Drive*** *is a CD drive formatted as* ***D:*** *or* ***E:***). A popup window will be displayed when the installation is launched. Refer to **Installation on Windows** section to follow the same steps to complete installation.

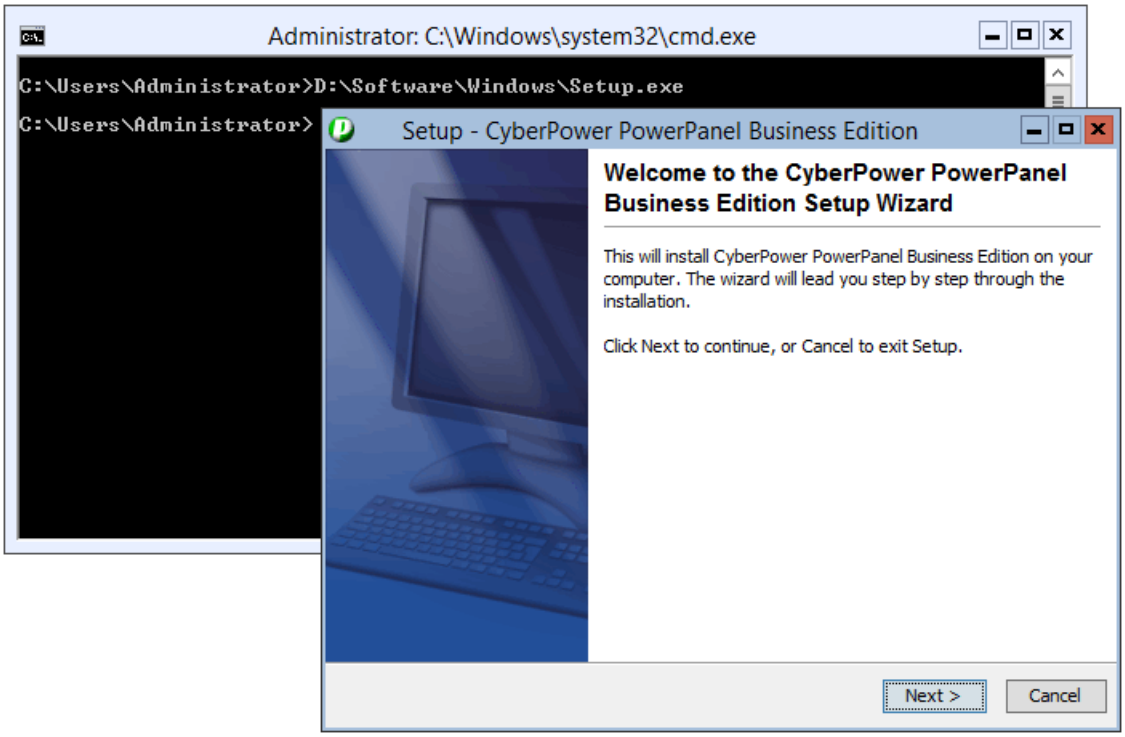
Administrator: C:\Windows\system32\cmd.exe
C:\Users\Administrator>D:\Software\Windows\Setup.exe
C:\Users\Administrator>
Setup - CyberPower PowerPanel Business Edition
Welcome to the CyberPower PowerPanel Business Edition Setup Wizard
This will install CyberPower PowerPanel Business Edition on your computer. The wizard will lead you step by step through the installation.
Click Next to continue, or Cancel to exit Setup.
Next >
Cancel

Access PowerPanel® Business Edition Software Interface

To access the PowerPanel® Business Edition interface in Windows, go to **Start > All Programs > CyberPower PowerPanel Business Edition > PowerPanel Business Edition Client** (or **PowerPanel Business Edition Center**), which will take you to the login page.

On Linux, user can also enter the URL as **http://localhost:3052/** in the address of the web browser to access to the interface. User can also enter the URL, **http://hosted_computer_ip_address:3052/**, in the address of the web browser to access the interface from a remote computer. **hosted_computer_ip_address** is the IP address of the host computer which has the PowerPanel® Business Edition installed. For vMA on the ESX or ESXi, **hosted_computer_ip_address** is the IP address of the vMA (**Note**: **hosted_computer_ip_address** is the IP address of the host computer on ESX.).

The default username is **admin** and the default password is **admin**. For security purposes, it is recommended you change the login username and password after the initial login.

PowerPanel® Business Edition supports multiple-language function and allows users to change language. It will choose the suitable language as the default one to display at the initial access. Users can change the language from the banner. After the language is changed, the page will refresh automatically and choose the assigned language as the default one to display.

Quick Configuration

A **Welcome** screen will display at the first time to use Client. The welcome screen will lead you to complete the quick configuration. You can decide whether to continue or ignore it. It is strongly recommended to complete the quick configuration. Inability to complete the quick configuration may put your computer in the extreme risk when power events occur. If you decide to ignore the quick configuration, click the **Exit** button. A popup confirm dialog will display and click the **Yes** button to ignore the quick configuration. Refer to **Import Profile** section for further details about completing the quick configuration.

Configure Power Protection for Computers

In order to ensure the computers which are connected to the UPS have sufficient time to complete the shutdown prior to turning off outlets, Client should be installed. The Client will establish communication with the UPS and receive

commands from the UPS for a complete shutdown to avoid data loss or a system crash. Refer the **Install PowerPanel® Business Edition Software** chapter for installing the Client.

Import Profile

The **Profile Import** screen provides a shortcut to import your own profile to complete the quick configuration. If you would like to import a profile, click the **Yes** option and click the **Next** button to import the profile. A popup dialog will ask you to assign the profile. After the profile import is complete, Client will show the result on the **Finish** screen.

If you would like complete the quick configuration without profile, click the **No** option and click **Next** button to continue.

Configure Authentication

In order to secure and protect the network communication with Client and UPS RMCARD, the security settings must be configured properly in the **Authentication** screen. The settings are used for authenticating the network communication between the Client and UPS RMCARD.

The Secret Phrase is configured on the **General/Identification** page of the UPS RMCARD web. The SNMP settings are configured on the **Network Service/SNMPv1 Service** and **Network Service/SNMPv3 Service** pages of the UPS RMCARD web. Click **Next** to the next step.

Assign IP Address of UPS Units and Connected Outlet

Communication can be established through the network by assigning the IP address of the UPS RMCARD and outlet assignment on the **Power Source Assignment** screen in the Client. In order to ensure the UPS RMCARD can respond to the Client normally, the community configuration must be setup properly.

Assign the IP address of the UPS RMCARD at the *Address* field or pick an address from the device list which shows all devices on the local network. Users have to assign the UPS output outlet which supplies power to the Client computer according to the actual connection. Click the **Apply** button for Client to establish the communication between Client and UPS RMCARD.

Configure Shutdown Settings

The **Shutdown Settings** screen allows you to specify the manner in which Client computer is shut down prior to a UPS powering off, set the duration which Client will take to shut down. Even if Client requires shutting down the VMware ESXi host, you can specify the root permission and the ESXi host address.

Setup Necessary Shutdown Time

Each computer running the Client requires sufficient time to be shut down completely before the UPS stops supplying power. Therefore users should set up this sufficient time at the *Necessary shutdown time* option on the **Shutdown Settings** screen in the Client.

Configure Shutdown Action for ESXi

In order to ensure the ESXi host and all virtual machines can be shut down correctly in case of power events, users have to configure the host address, account and password of the root user for the host shutdown from vMA. Fill in the *Host Address, Account* and *Password* fields with actual username and password for ESXi host.

***Note**: **Host Address** is the IP address of the ESXi host computer on which vMA is operating but not the IP address of vMA.*

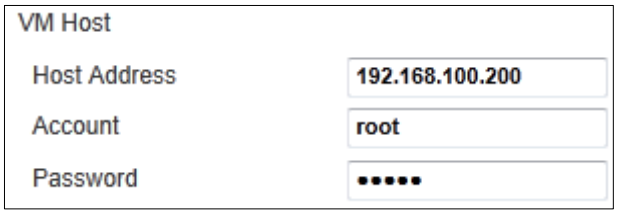

***Note:** In order to allow the interactions between physical and virtual machines, VMware tools must be installed on each virtual machine. Refer to VMware ESX/ESXi Server documentation for further information about VMware Tools.*

Configure Startup and Shutdown of Virtual Machines on ESXi

In order to ensure that all virtual machines and VMware ESX/ESXi server host can be shut down and restart gracefully.

- Select the topmost VMware ESX/ESXi server host from the tree hierarchy on the left side. Go to **Configuration** → **Virtual Machine Startup/Shutdown** menu → **Properties** of the vSphere Client.

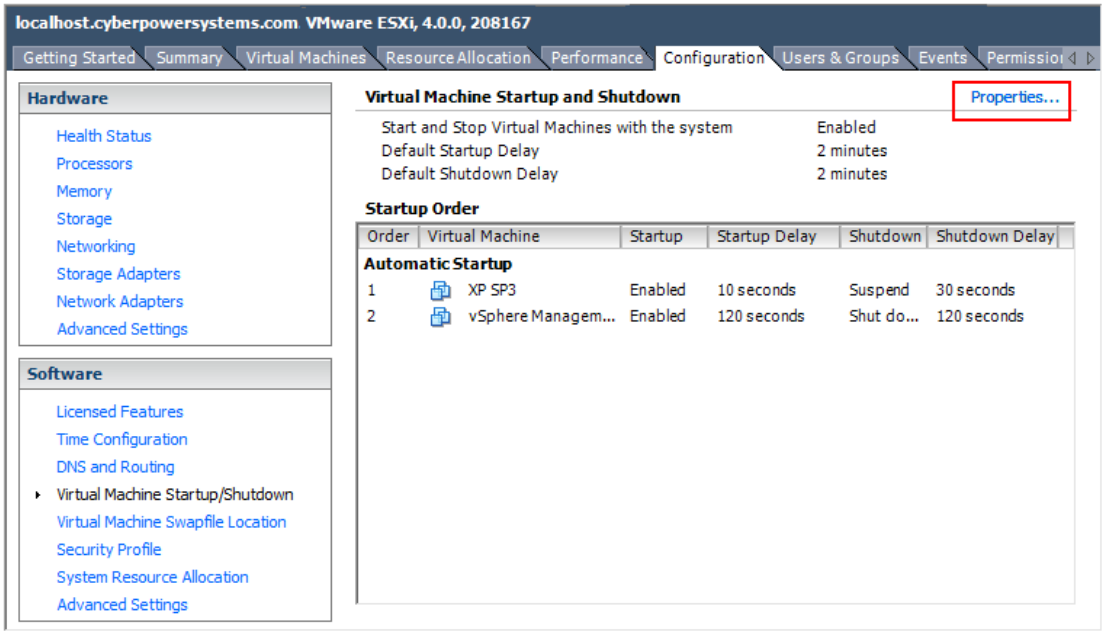

- Enable the **Allow virtual machines to start and stop automatically with the system** option.

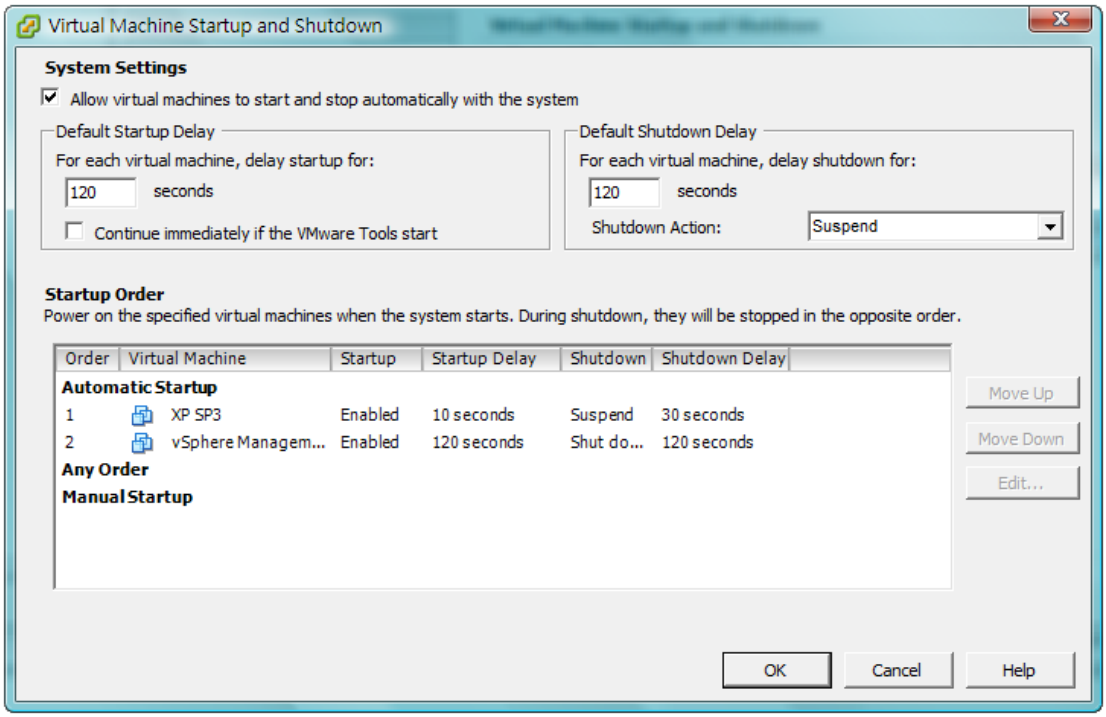

Configure Shutdown of Virtual Machines on Hyper-V Server

In order for the virtual machines to be shut down correctly when the Hyper-V host shuts down, users should configure a guest operating system shutdown on each virtual machine.

Follow below steps to configure the guest virtual machine to shut down with the host:

- Using the Hyper-V Manager to choose a VM and the click **Settings**.

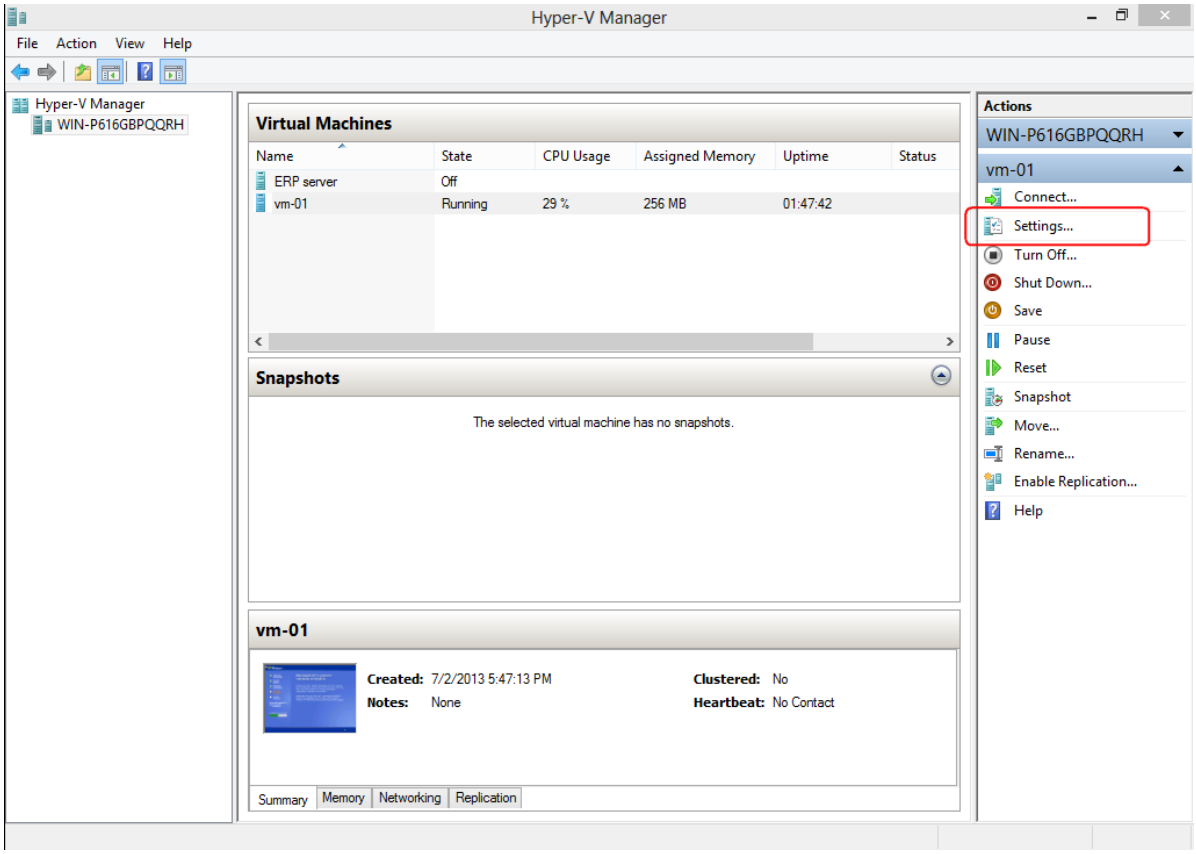

- Choose the **Automatic Stop Action** and choose **Shut down the guest operating system**.

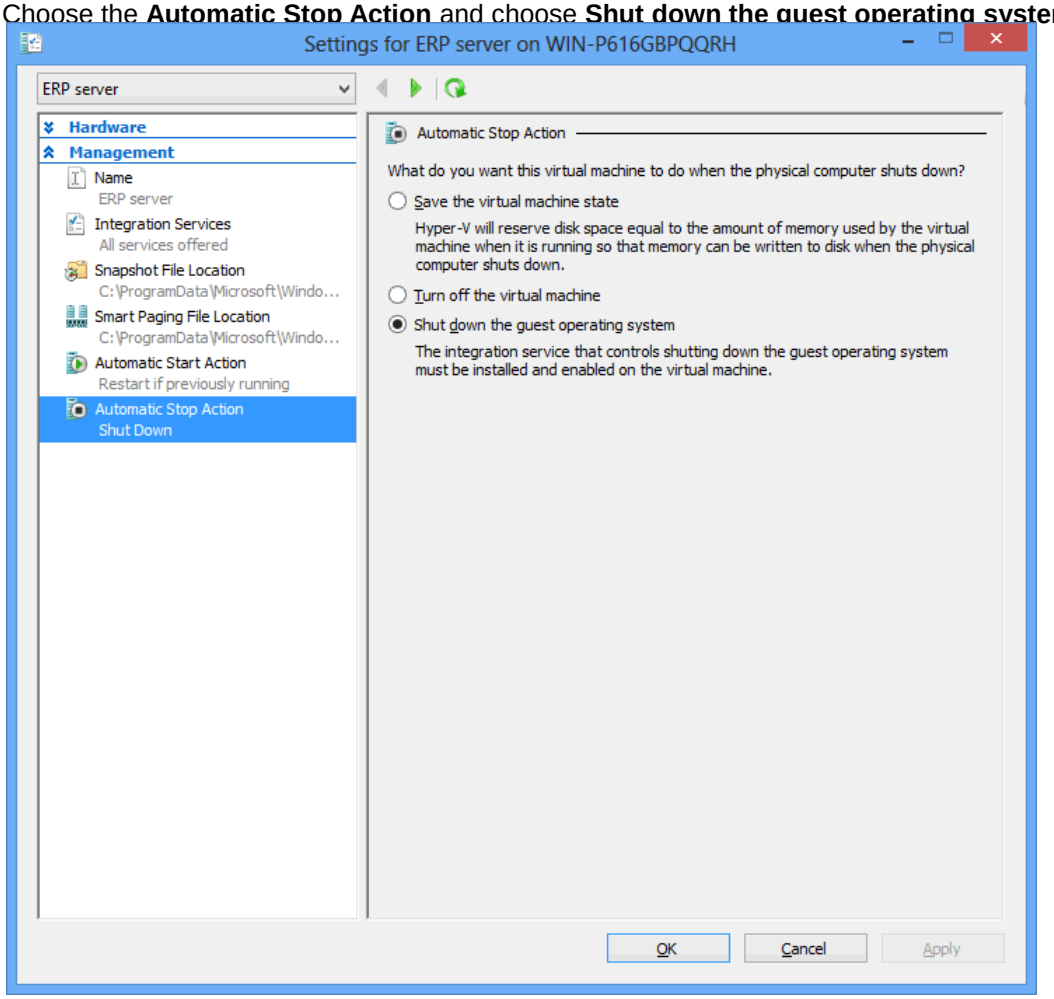
Settings for ERP server on WIN-P616GBPQQRH
ERP server
Hardware
Management
Name
ERP server
Integration Services
All services offered
Snapshot File Location
C:\ProgramData\Microsoft\Windo...
Smart Paging File Location
C:\ProgramData\Microsoft\Windo...
Automatic Start Action
Restart if previously running
Automatic Stop Action
Shut Down
Automatic Stop Action
What do you want this virtual machine to do when the physical computer shuts down?
Save the virtual machine state
Hyper-V will reserve disk space equal to the amount of memory used by the virtual machine when it is running so that memory can be written to disk when the physical computer shuts down.
Turn off the virtual machine
Shut down the guest operating system
The integration service that controls shutting down the guest operating system must be installed and enabled on the virtual machine.
OK
Cancel
Apply

Hyper-V server will shut itself down only after the running virtual machines shut down. Ensure that the *Necessary shutdown time* must be sufficient to support the virtual machines to shut down and the Hyper-V server to shut down.

***Note**: In order to allow the interactions between physical and virtual machines, Hyper-V Integration Service (HIS) have to be installed on each virtual machine by accessing **Insert Integration Services setup disk** item from the **Action** menu of each virtual machine's console.*

If the virtual machine is running a Linux distribution, refer to the Linux Integration Services for Hyper-V page to download and re install the Linux integration service for Hyper-V.

Configure Actions for Essential Events

The **Event Action** screen lists the following critical events and action settings for each event according to actual power connection. Client will generate actions in response to events when UPS encounter the power conditions.

- **Battery capacity is critically low.** *Battery capacity is critically low; power could be lost immediately.*
- **Output overload.** *Power consumption exceeds the power rating of UPS. If the overload is sustained, the UPS will shut off*
- **Network communication lost with UPS in a power event.** *Communication with the UPS has been lost after a power event occurred.* When the utility power becomes abnormal and the UPS is using the battery to supply power, loss of network communication between the Client and UPS causes the Client to generate a critical priority event because it cannot respond to changes in the status of utility and battery power.

- **The output power is going to stop soon.** *Output power will stop due to power event or user commands. The Client will shut down the hosted computer.*
- **Utility power failure.** *Utility power failure, battery power will be supplied***.**

Note: *Refer to PPBE user's manual for more details about more events which are not available in this screen.*

In order to protect your computer when power events occur, you have to arrange the shutdown action for events. After the actions are configured properly, click **Next** to the next step.

Make Sure Power Configuration is Correct

The **Finish** screen lists all power configurations through entire quick configuration. In order to make sure that your computer can be protected when power events occur, you must review the power configuration. Click **Finish** button to complete the quick configuration if the power configuration is correct.

Mass Deployment

In order to install Client on more computers and apply the same settings, users can follow below steps to complete the automatic deployment:

- **Export Profile.** Choose one target Client to export its power configuration and system settings to the profile on the **Preferences/Profile** page.
- Copy below example code to the text editor and save as new file named **setup.varfile**.

```
installModule=client
programGroupName=CyberPower PowerPanel Business Edition
installationDir=ppbe_installation_directory
profilePath=exported_zip_location
```

- Edit the **setup.varfile** to replace **installationDir** and **profile** parameters. **installationDir** indicates the absolute path of installation directory for Client (e.g. *C:/Programs/CyberPower PowerPanel Business Edition/PowerPanel Business Edition* or */opt/ppbe*). **profilePath** indicates the absolute path of profile (e.g. *C:/import/profile.zip* or */import/profile.zip*).
- Place the **setup.varfile** and installer in the same directory. Make sure that the filename must be the same (e.g. **setup.exe** and **setup.varfile**).
- For Windows users, running the below command in the command prompt to complete the installation.

```
setup.exe –q –console –Dinstall4j.detailStdout=true
```

- For Linux users, running the below command in terminal to complete the installation.

```
sudo setup.sh –q –console –Dinstall4j.detailStdout=true
```

Note*. When you would like to upgrade the pre-installed Agent or Client during the unattended installation, set the* ***installationDir*** *parameter blank. The installer will automatically detect where preinstallation PPBE directory locates and attempt to complete the upgrade installation.*

Computers which never installed Agent or Client can be installed the PPBE by assigning a valid path. Assigning a blank path to the ***installationDir*** *parameter during the unattended installation will allow the installer to use the default path as the installation directory.* ***C:/Program Files/CyberPower PowerPanel Business Edition/*** *will be the default*

installation directory in Windows systems. ***/opt/ppbe*** *or* ***/usr/local/ppbe*** *will be the default installation directory in most Linux distributions.*

Manage UPS Units in Center

If the administrator requires monitoring multiple UPS units on the local network at one time, PowerPanel® Business Edition Center should be installed. The Center can gather the state and events from the monitored UPS units and the monitored UPS units can also accept commands from the Center for shutting off or restarting. Computers running Client can be ordered to initiate a graceful shutdown. Refer to **Installing PowerPanel® Business Edition Software** chapter for further details about Center installation.

The Center can also establish communication with multiple UPS units. Monitored UPS units will relay the state to the Center and notify Center when and what power event occurs.

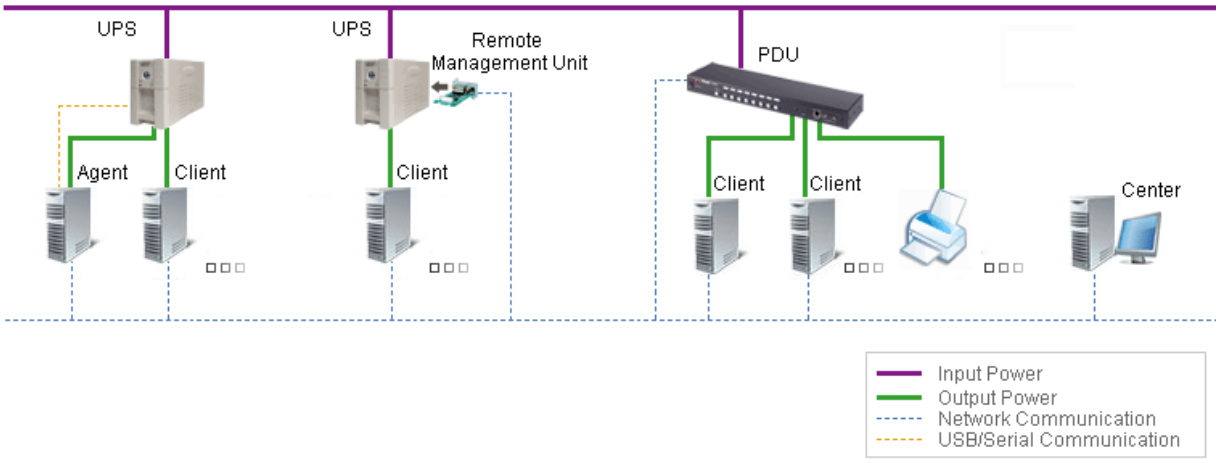

Add UPS Units

Users can monitor and control multiple UPS on the **Management/Power Equipment** page by accessing the *Add Device* window to add UPS to Center as below:

The *Add Device* window can be accessed by clicking the *Add Device* button of the toolbar or selecting the *Add Device* in the context menu of any one group node.

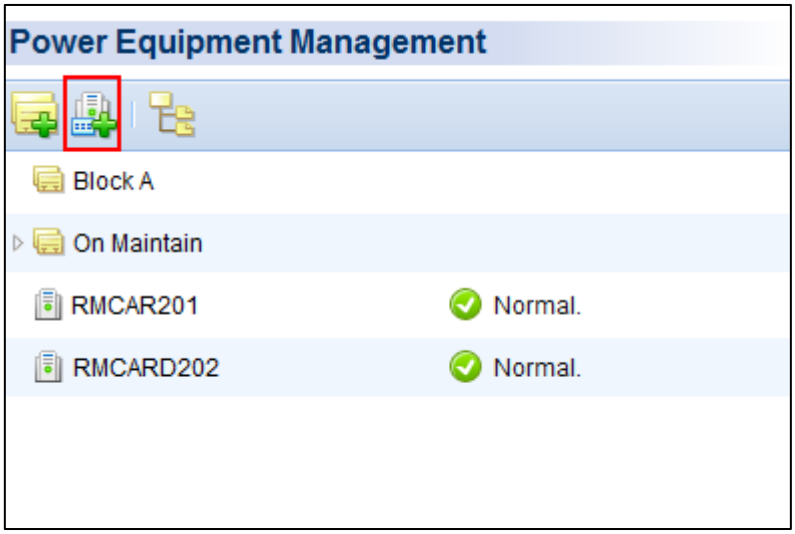

Either enter the IP address of the UPS RMCARD on the *Device Address* field or click the **Browse** button to display the device list and select the IP address from the list. Click **OK** to proceed to add the selected UPS.

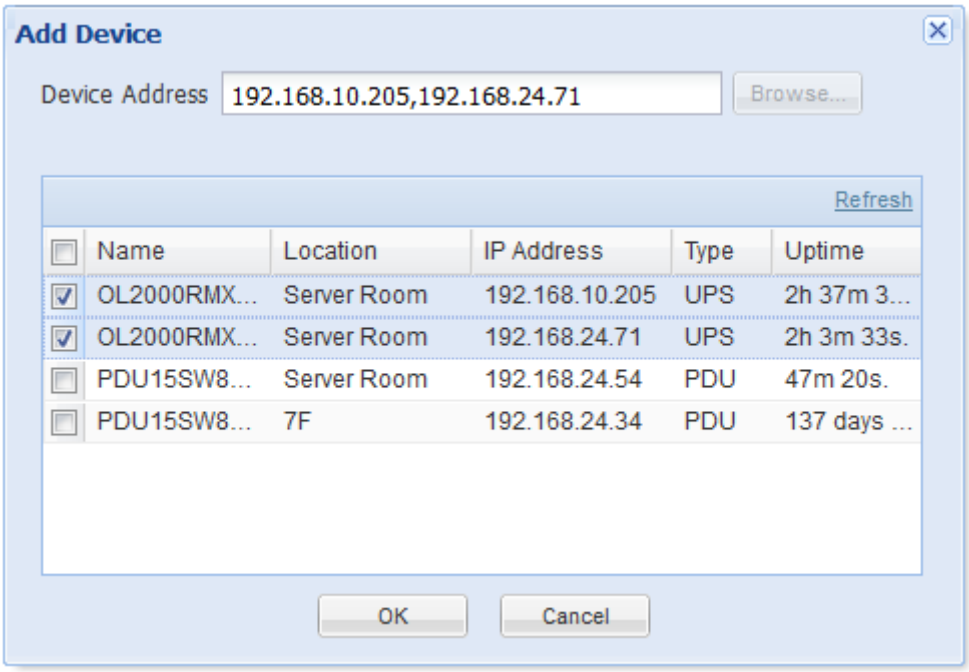

Note: *If users require adding multiple UPS units to Center, repeat the aforementioned steps.*

Note: Please refer to **PPBE User's Manual** about further details of more functions about Center.